

Management Survey with part Refurbishment/Demolition (MA only)

**At
14 Jersey Close
Basingstoke
Hampshire,
RG24 9PR**

On Behalf Of:

Sanctuary Group

Scope of Survey Works

Management survey to whole property, refurbishment survey to the bathroom



**ASBESTOS LOCATED
THIS REPORT CONTAINS AREAS NOT ACCESSED**

Job Number	J276836
------------	---------

Page: 1 of 40

REPORT AUTHORITIES

This asbestos survey and subsequent report at 14 Jersey Close, Basingstoke, Hampshire, RG24 9PR has been completed by George Dutton following a site visit (s) on 14 March 2023 on behalf of Sanctuary Group, Sanctuary House, Chamber Court, Castle Street, Worcester, Worcestershire, WR1 3ZQ.

This report has been technically reviewed by Mike Mohan on 21 Mar 2023

Approval to issue the report has been granted by the Quality Team, technical review of the report has been completed by authorised persons named below.


Below are the signatures of the report authorities:

Surveyor 1 Signature:



George Dutton

Report Technically Reviewed By:



Mike Mohan

Surveyor 2 Signature:



Report issued under the authority of the Quality / Technical Manager:



Paul Darby

Contents

EXECUTIVE SUMMARY.....	4
ASBESTOS REGISTER.....	6
NON-ASBESTOS REGISTER.....	7
MATERIAL ASSESSMENT SHEET.....	11
SURVEY OBJECTIVES & TECHNIQUE.....	12
ALGORITHM ASSESSMENTS.....	27
SURVEY RECOMMENDATION DETAIL – Material Assessment.....	28
REPORT CAVEATS – Targeted Survey (Management Survey with Intrusive Elements).....	29
BULK CERTIFICATE.....	30
SITE PLAN.....	32
LEGISLATION.....	36
TERMS & CONDITIONS.....	37

EXECUTIVE SUMMARY

?

Detailed Scope of Works:

Management survey to whole property, refurbishment survey to the bathroom

A Management Survey with part Refurbishment/Demolition was undertaken at 14 Jersey Close, Basingstoke, Hampshire on 14 March 2023 on behalf of Sanctuary Group to determine the asbestos materials that may exist within the scope of a Management Survey with part Refurbishment/Demolition. The client specific scope of works to be read in conjunction with this report where appropriate.

Internal Notes: See notes

External Notes: See notes

Areas and rooms included in this survey were:

Building Number / Name:	Floor / Level:	Areas Name:	Area Number:
1 / Three bedroom house	External	External	E01
1 / Three bedroom house	Ground	Hall	G01
1 / Three bedroom house	Ground	Toilet	G02
1 / Three bedroom house	Ground	Kitchen	G03
1 / Three bedroom house	Ground	Living Room	G04
1 / Three bedroom house	First	Landing	101
1 / Three bedroom house	First	Bedroom	102
1 / Three bedroom house	First	Bedroom	103
1 / Three bedroom house	First	Bathroom	104
1 / Three bedroom house	First	Cupboard	105

Job Number: J276836
Survey Date: 14 March 2023
Site Address: 14 Jersey Close



Building Number / Name:	Floor / Level:	Areas Name:	Area Number:
1 / Three bedroom house	First	Bedroom	106

Job Number: J276836
Survey Date: 14 March 2023
Site Address: 14 Jersey Close

ASBESTOS REGISTER

INSPECTION NO	BUILDING	LOCATION	SAMPLE NO	DESCRIPTION	EXTENT	PRODUCT TYPE (MA)	DAMAGE (MA)	SURFACE TREATMENT (MA)	ASBESTOS TYPE (MA)	TOTAL MA SCORE (MA)	ACTION
9	1 / Three bedroom house	First / Cupboard 105 / to door	GD011026	Asbestos Insulating Board	2m ²	Asbestos Insulating Board (2)	Low Damage (1)	Surface Sealed (1)	Chrysotile Amosite (2)	Low (6)	Remove
11	1 / Three bedroom house	First / Cupboard 105 / to boxing	GD011027	Asbestos Insulating Board	1m ²	Asbestos Insulating Board (2)	Low Damage (1)	Surface Sealed (1)	Chrysotile Amosite (2)	Low (6)	Remove

NON-ASBESTOS REGISTER


INSPECTION NO (MA - PA)	BUILDING (MA)	LOCATION (MA)	SAMPLE NO (MA)	DESCRIPTION (MA)	EXTENT (MA)	PRODUCT TYPE (MA)	DAMAGE (MA)	SURFACE TREATMENT (MA)	ASBESTOS TYPE (MA)	TOTAL MA SCORE (MA)	ACTION
1	1 / Three bedroom house	Ground / Hall G01 / to ceiling	GD011023	Decorative Finishes Rooms up to 100m ²	6m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable
2	1 / Three bedroom house	Ground / Toilet G02 / to ceiling	AS GD011023	Decorative Finishes Rooms up to 100m ²	2m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable
3	1 / Three bedroom house	Ground / Kitchen G03	Visual	No suspect materials visually found		-		-	-	0	No further action required
4	1 / Three bedroom house	Ground / Living Room G04 / to ceiling	AS GD011023	Decorative Finishes Rooms up to 100m ²	20m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable
5	1 / Three bedroom house	First / Landing 101 / to ceiling	GD011024	Decorative Finishes Rooms up to 100m ²	8m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable
6	1 / Three bedroom house	First / Bedroom 102 / to ceiling	AS GD011024	Decorative Finishes Rooms up to 100m ²	12m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable
7	1 / Three bedroom house	First / Bedroom 103 / to ceiling	AS GD011024	Decorative Finishes Rooms up to 100m ²	10m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable
8	1 / Three bedroom house	First / Bathroom 104 / to ceiling	GD011025	Decorative Finishes Rooms up to 100m ²	8m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable

NON-ASBESTOS REGISTER

INSPECTION NO (MA - PA)	BUILDING (MA)	LOCATION (MA)	SAMPLE NO (MA)	DESCRIPTION (MA)	EXTENT (MA)	PRODUCT TYPE (MA)	DAMAGE (MA)	SURFACE TREATMENT (MA)	ASBESTOS TYPE (MA)	TOTAL MA SCORE (MA)	ACTION
10	1 / Three bedroom house	First / Cupboard 105 / to ceiling	AS GD011025	Decorative Finishes Rooms up to 100m ²	1m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable
12	1 / Three bedroom house	First / Bedroom 106 / to ceiling	AS GD011024	Decorative Finishes Rooms up to 100m ²	12m ²	Textured Coating	0	Surface Sealed (1)	No Asbestos Detected	0	Not applicable
14	1 / Three bedroom house	External / External E01	Visual	No suspect materials visually found		-		-	-	0	No further action required

Job Number: J276836
Survey Date: 14 March 2023
Site Address: 14 Jersey Close

No Access Register

Inspection No	Building	Location:	Description:	Reason	Recommendation	Photo
13	1 / Three bedroom house	Roof / Loft Space R01	Loft Space		Inspect Prior to Disturbance	

Job Number: J276836
Survey Date: 14 March 2023
Site Address: 14 Jersey Close



Limited Access register

Inspection No	Building	Location:	Description:	Reason	Recommendation	Photo
N/A						

Asbestos materials were identified in the following locations:

Inspection Number / Location:	Asbestos Type / Product:	Extent:	Recommendation:
GD011026 - 9 / First / Cupboard 105	Chrysotile Amosite Asbestos Insulating Board to door	2 m ²	Remove
GD011027 - 11 / First / Cupboard 105	Chrysotile Amosite Asbestos Insulating Board to boxing	1 m ²	Remove

SURVEY OBJECTIVES & TECHNIQUE

Objectives


- 1) To undertake a Management Survey with part Refurbishment/Demolition (MA only) survey of the site detailed following the guidelines as detailed in HSG264 Asbestos – The survey guide and our UKAS accredited procedures. The purpose and procedures of this survey was to inspect all accessible areas within the scope of the survey and to take representative samples of any suspect materials identified. Where appropriate the survey included the inspection of any voids these would only be inspected on refurbishment or demolition surveys unless screw fixing or hatches are available.
- 2) To undertake a risk assessment of all suspect materials identified to enable the Client to formulate an Action Plan as in conformance with the Health & Safety Executive's guidance document HSG227.
- 3) To produce a report, in a database format, detailing all identified and presumed asbestos containing materials, which includes a Site Plan showing their location and data sheets detailing their risk assessments and showing a photograph of the material in-situ.

Survey Technique

- 1) Each room/area within the scope of this survey was surveyed according to the survey type requested to assess whether or not suspect materials that could potentially contain asbestos fibres are present.
- 2) Representative samples of suspect materials identified were taken and returned to our Laboratory for analysis by the Polarised Light and Dispersion Staining Technique method as detailed in Appendix 2 of the Health & Safety Executive's guidance document HSG 248 and our UKAS accredited procedures.
- 3) Where for safety reasons (i.e. height restrictions, etc) or other physical restrictions a suspect material could not be physically sampled the material was presumed to contain asbestos and noted as such at the time of the survey. All presumed asbestos materials should be treated as containing asbestos as part of the Asbestos Management Plan until subsequent sampling and analysis deem otherwise.
- 4) Where access could not be gained into a room/area at the time of the survey this is recorded as 'No Access'. Areas identified as being No Access should be treated as containing asbestos materials as part of the Asbestos Management Plan until subsequent inspection deems otherwise.
- 5) Where access could not be fully gained into an area due to safety reasons (e.g. non boarded loft spaces) or due to physical restrictions at the time of the survey this is recorded as 'Limited Access'. Armstrong York cannot guarantee that all asbestos containing materials have been identified within in areas identified as being Limited Access. These areas should be treated as "No Access" areas for the purposes of the Management Plan although some identified asbestos materials may be recorded for these areas where access to the material could be achieved
- 6) Access into electrical plant or mechanical services would not be gained unless the services are isolated and safe. Only in a refurbishment or demolition survey would this be requested by the client.
- 7) Where a material type previously sampled in one location is visually identified as being present to other locations it was strongly presumed that these installations are of the same composition as the one sampled which was recorded as being "AS" Sample


MATERIAL ASSESSMENT SHEET

Inspection Number:	1	Intrusive Area – Yes or No:	No
Material Assessment			
Item:		Detail:	
Building:		1 / Three bedroom house	
Location:		Ground / Hall G01	
Sample Number:		GD011023	
Description:		Decorative Finishes	
Position:		to ceiling	
Extent:		6m ²	
Product Type:		Textured Coating	
Damage & Deterioration:		Low Damage	
Surface Treatment:		Enclosed sprays and lagging, Sealed AIB	
Asbestos Type:		No Asbestos Detected	
Material Score:		0	

Room Comments:	plasterboard ceiling solid walls with plaster skim. Concrete floor with laminate flooring above. Timber doors and frames.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	2	Intrusive Area – Yes or No:	No
Material Assessment			
Item:		Detail:	
Building:		1 / Three bedroom house	
Location:		Ground / Toilet G02	
Sample Number:		AS GD011023	
Description:		Decorative Finishes	
Position:		to ceiling	
Extent:		2m ²	
Product Type:		Textured Coating	
Damage & Deterioration:		Low Damage	
Surface Treatment:		Enclosed sprays and lagging, Sealed AIB	
Asbestos Type:		No Asbestos Detected	
Material Score:		0	

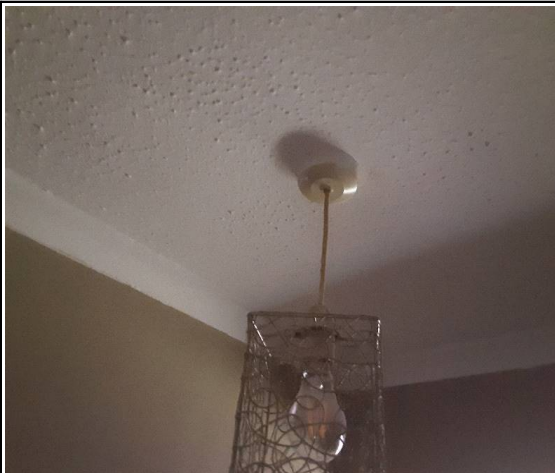Room Comments:	plasterboard ceiling solid walls with plaster skim. Concrete floor with laminate flooring above. Upvc windows. Ceramic toilet and cistern. Timber door and frame.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	3	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	Ground / Kitchen G03		
Sample Number:	Visual		
Description:	No suspect materials visually found		
Position:			
Extent:			
Product Type:	N/A		
Damage & Deterioration:	N/A		
Surface Treatment:	N/A		
Asbestos Type:	-		
Material Score:	0		

Room Comments:	plasterboard ceiling solid walls with plaster skim. Concrete floor with modern plastic covering. Upvc windows. Boiler fixed to solid wall with metal flue passing through external wall. Timber door and frame.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	4	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	Ground / Living Room G04		
Sample Number:	AS GD011023		
Description:	Decorative Finishes		
Position:	to ceiling		
Extent:	20m ²		
Product Type:	Textured Coating		
Damage & Deterioration:	Low Damage		
Surface Treatment:	Enclosed sprays and lagging, Sealed AIB		
Asbestos Type:	No Asbestos Detected		
Material Score:	0		

Room Comments:	plasterboard ceiling solid walls with plaster skim. Concrete floor with laminate flooring above. Upvc windows. Timber door and frame.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	5	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	First / Landing 101		
Sample Number:	GD011024		
Description:	Decorative Finishes		
Position:	to ceiling		
Extent:	8m ²		
Product Type:	Textured Coating		
Damage & Deterioration:	Low Damage		
Surface Treatment:	Enclosed sprays and lagging, Sealed AIB		
Asbestos Type:	No Asbestos Detected		
Material Score:	0		

Room Comments:	plasterboard ceiling solid walls with plaster skim. Wooden floorboards and stairs with carpets covering. Timber doors and frames.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	6	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	First / Bedroom 102		
Sample Number:	AS GD011024		
Description:	Decorative Finishes		
Position:	to ceiling		
Extent:	12m ²		
Product Type:	Textured Coating		
Damage & Deterioration:	Low Damage		
Surface Treatment:	Enclosed sprays and lagging, Sealed AIB		
Asbestos Type:	No Asbestos Detected		
Material Score:	0		

Room Comments:	plasterboard ceiling solid walls with plaster skim. Wooden floorboards with carpets covering. Upvc windows. Timber door and frame with glass above.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	7	Intrusive Area – Yes or No:	No
Material Assessment			
Item:		Detail:	
Building:		1 / Three bedroom house	
Location:		First / Bedroom 103	
Sample Number:		AS GD011024	
Description:		Decorative Finishes	
Position:		to ceiling	
Extent:		10m ²	
Product Type:		Textured Coating	
Damage & Deterioration:		Low Damage	
Surface Treatment:		Enclosed sprays and lagging, Sealed AIB	
Asbestos Type:		No Asbestos Detected	
Material Score:		0	

Room Comments:	plasterboard ceiling solid walls with plaster skim. Wooden floorboards with carpets covering. Upvc windows. Timber door and frame with glass above.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	8	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	First / Bathroom 104		
Sample Number:	GD011025		
Description:	Decorative Finishes		
Position:	to ceiling		
Extent:	8m ²		
Product Type:	Textured Coating		
Damage & Deterioration:	Low Damage		
Surface Treatment:	Enclosed sprays and lagging, Sealed AIB		
Asbestos Type:	No Asbestos Detected		
Material Score:	0		

Room Comments:	plasterboard ceiling solid walls with plaster skim. Wooden floorboards with modern plastic covering. Metal bath with plastic panel. Ceramic toilet and cistern. Upvc windows. Timber door and frame with glass above.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	9	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	First / Cupboard 105		
Sample Number:	GD011026		
Description:	Asbestos Insulating Board		
Position:	to door		
Extent:	2m ²		
Product Type:	Asbestos Insulating Board		
Damage & Deterioration:	Low Damage		
Surface Treatment:	Enclosed sprays and lagging, Sealed AIB		
Asbestos Type:	Chrysotile + Amosite		
Material Score:	6		

Room Comments:	plasterboard ceiling solid walls with plaster skim. Wooden floorboards. Copper cylinder with foam lagging. Timber door and frame.	
Sample Comments:	N/A	
Total Assessment Score:	6	
Risk Assessment Category:	Low	
Recommendation:	Remove	


MATERIAL ASSESSMENT SHEET

Inspection Number:	10	Intrusive Area – Yes or No:	No
Material Assessment			
Item:		Detail:	
Building:		1 / Three bedroom house	
Location:		First / Cupboard 105	
Sample Number:		AS GD011025	
Description:		Decorative Finishes	
Position:		to ceiling	
Extent:		1m ²	
Product Type:		Textured Coating	
Damage & Deterioration:		Low Damage	
Surface Treatment:		Enclosed sprays and lagging, Sealed AIB	
Asbestos Type:		No Asbestos Detected	
Material Score:		0	

Room Comments:	plasterboard ceiling solid walls with plaster skim. Wooden floorboards. Copper cylinder with foam lagging. Timber door and frame.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	11	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	First / Cupboard 105		
Sample Number:	GD011027		
Description:	Asbestos Insulating Board		
Position:	to boxing		
Extent:	1m ²		
Product Type:	Asbestos Insulating Board		
Damage & Deterioration:	Low Damage		
Surface Treatment:	Enclosed sprays and lagging, Sealed AIB		
Asbestos Type:	Chrysotile + Amosite		
Material Score:	6		

Room Comments:	plasterboard ceiling solid walls with plaster skim. Wooden floorboards. Copper cylinder with foam lagging. Timber door and frame.	
Sample Comments:	N/A	
Total Assessment Score:	6	
Risk Assessment Category:	Low	
Recommendation:	Remove	

MATERIAL ASSESSMENT SHEET

Inspection Number:	12	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	First / Bedroom 106		
Sample Number:	AS GD011024		
Description:	Decorative Finishes		
Position:	to ceiling		
Extent:	12m ²		
Product Type:	Textured Coating		
Damage & Deterioration:	Low Damage		
Surface Treatment:	Enclosed sprays and lagging, Sealed AIB		
Asbestos Type:	No Asbestos Detected		
Material Score:	0		

Room Comments:	plasterboard ceiling solid walls with plaster skim. Wooden floorboards with carpets covering. Upvc windows. Timber door and frame with glass above.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	


MATERIAL ASSESSMENT SHEET

Inspection Number:	13	Intrusive Area – Yes or No:	No
Material Assessment			
Item:		Detail:	
Building:		1 / Three bedroom house	
Location:		Roof / Loft Space R01	
Sample Number:		Visual	
Description:		Inaccessible	
Position:			
Extent:			
Product Type:		N/A	
Damage & Deterioration:		N/A	
Surface Treatment:		N/A	
Asbestos Type:		N/A	
Material Score:		N/A	

Room Comments:	Stored items	
Sample Comments:	Stored items	
Total Assessment Score:	12	
Risk Assessment Category:		
Recommendation:	Inspect prior to disturbance	

MATERIAL ASSESSMENT SHEET

Inspection Number:	14	Intrusive Area – Yes or No:	No
Material Assessment			
Item:	Detail:		
Building:	1 / Three bedroom house		
Location:	External / External E01		
Sample Number:	Visual		
Description:	No suspect materials visually found		
Position:			
Extent:			
Product Type:	N/A		
Damage & Deterioration:	N/A		
Surface Treatment:	N/A		
Asbestos Type:	-		
Material Score:	0		

Room Comments:	Two storey building with pitched stone tiled roof. Wooden fascia boards plastic gutters and downpipe.	
Sample Comments:	N/A	
Total Assessment Score:	0	
Risk Assessment Category:	N/A	
Recommendation:	Not applicable	

ALGORITHM ASSEMENTS

Material Assessment	Score	Examples of scores
Product Type	1	Asbestos-reinforced composites (plastics, resins, mastics, roofing felts, vinyl floor tiles, semi-rigid paints or decorative finishes, asbestos cement etc.)
	2	AIB, millboards, other low-density insulation boards, asbestos textiles, gaskets, ropes and woven textiles, asbestos paper and felt.
	3	Thermal insulation (eg pipe and boiler lagging, sprayed asbestos, loose asbestos, asbestos mattresses and packing)
Damage/Condition	0	Good condition: No visible damage
	1	Low damage: a few scratches or surface marks, broken edges on boards, tiles etc.
	2	Medium damage: significant breakage of materials or several small areas where material has been damaged revealing loose asbestos fibres.
	3	High damage or delamination of materials, sprays and thermal insulation. Visible asbestos debris.
Surface Treatment	0	Composite materials containing asbestos: reinforced plastics, resins, vinyl tiles
	1	Enclosed sprays and lagging, AIB (with exposed face painted or encapsulated) asbestos cement sheets etc.
	2	Unsealed AIB, textiles or encapsulated lagging and sprays.
	3	Unsealed lagging and sprays.
Asbestos Type	1	Chrysotile.
	2	Amphibole asbestos excluding crocidolite.
	3	Crocidolite.

SURVEY RECOMMENDATION DETAIL – Material Assessment

The **Material Assessment** is an assessment of the likelihood of an ACM to release fibres when there is air disturbance in its locality. This assessment is used to identify the low, medium and high risk materials as a starting point for a management plan. HSG264 recommends the use of an algorithm to determine the assessment and details scores for the following parameters.

The 4 scoring areas of the algorithm are:

Product type
Extent of damage
Surface treatment
Asbestos type

Each of the parameters is scored and added to give a total score between 2 and 12:



- a) Materials with scores of 10 or more should be regarded as HIGH RISK material – Recommended Action – Remove
- b) Materials with a score between 7 and 9 are MEDIUM RISK materials – Action – Manage & Monitor (Remove / Encapsulate) if required
- c) Materials with a score between 5 and 6 are LOW RISK – Action – Manage & Monitor (Encapsulate) if required
- d) Materials with a scores of 4 or less are VERY LOW RISK – Action – Manage & Monitor (Encapsulate) if required
- e) No Asbestos Detected in sample – No recommendation required

Material Assessments are completed at the time of the survey for all suspect materials identified. The material score is based upon the HSG 264 requirement but the specific recommendations are assessed by the surveyor on the day of survey and manually inserted. The recommendation is not automatically linked to the material / priority score therefore if debris or poor condition ACM's are reported "Remove" may be the inserted as the overall recommendation. Specific client requirements may in place at the contract review stage requesting a bespoke recommendation.

REPORT CAVEATS – Management Survey – Targeted Intrusive Elements

- 1) During the course of the survey all reasonable efforts were made to identify the physical presence of asbestos containing materials within the management survey. We cannot guarantee that all asbestos containing materials were identified during the survey due to the nature of the use of asbestos materials as packing materials, etc within the fabric of buildings or due to past repairs/refurbishment works resulting in mixtures of non-asbestos and asbestos materials being present in the same locations.
- 2) If in the future any suspicious materials are found which are not included in this report then any work in that area should cease and arrangements made for their subsequent sampling and analysis by a UKAS accredited laboratory.
- 3) The site plans detailed in this report are given for illustrative purposes only to indicate the general location of areas and are not to scale.
- 4) The extents of materials detailed in this report are approximations and given for guidance purposes only. This report should not be used as the sole tendering document for futures asbestos abatement works.
- 5) Where asbestos insulating board or asbestos cement are identified the type of material stated is based on visual assessment only and unless stated no 'Water Absorption' test as detailed in HSG248 was undertaken to determine the type of material.
- 6) This report details the findings of the survey on the date(s) the investigation took place.
- 7) Glossary of Terms: NAD - No Asbestos Detected, NAVD – No Asbestos Visually Detected, AC – Asbestos Cement, AIB – Asbestos Insulating Board, NSMVF – No Suspect Materials Visually Found
- 8) Specific areas for intrusive works were agreed in advance at the planning stage. The management survey to all other areas are as noted above.
- 9) On the intrusive areas the material assessment states that these areas have been accessed as a refurbishment survey and the recommendation for all ACM's in those areas will be "Remove"
- 10) All client documentation will be saved on Armstrong York's secure server.

BULK CERTIFICATE

	ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD			
CERTIFICATE OF ASBESTOS IDENTIFICATION				
Client:	Sanctuary Group			
Address:	Sanctuary House, Chamber Court, Castle Street, Worcester, Worcestershire,,WR1 3ZQ	Report No:	J276836	
Site Address:	14 Jersey Close, Basingstoke, Hampshire, RG24 9PR	Report Date:	21 Mar 2023	
Date Sample taken:	06 Mar 2023	Site Reference:		
Date Received:	15 Mar 2023	Number of Samples:	5	
Date Analysed:	21 Mar 2023	Analysed At:	Stanford Le Hope	
Client/ Sample No	Sample Location / Description	Internal Sample Notes:	Fibre Type Detected	
GD011023	Ground Floor Hall 01 Decorative Finishes to ceiling	No notes on sample	No Asbestos Detected	
GD011024	1st Floor Landing 01 Decorative Finishes to ceiling	No notes on sample	No Asbestos Detected	
GD011025	1st Floor Bathroom 04 Decorative Finishes to ceiling	No notes on sample	No Asbestos Detected	
GD011026	1st Floor Cupboard 05 Asbestos Insulating Board to door	No notes on sample	Chrysotile + Amosite	
GD011027	1st Floor Cupboard 05 Asbestos Insulating Board to boxing	No notes on sample	Chrysotile + Amosite	






ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD



CERTIFICATE OF ASBESTOS IDENTIFICATION

Client:	Sanctuary Group		
Address:	Sanctuary House, Chamber Court, Castle Street, Worcester, Worcestershire, WR1 3ZQ	Report No:	J276836
Site Address:	14 Jersey Close, Basingstoke, Hampshire, RG24 9PR	Report Date:	21 Mar 2023
Date Sample taken:	14 Mar 2023	Site Reference:	N/A
Date Received:	15 Mar 2023	Number of Samples:	5
Date Analysed:	21 Mar 2023	Analysed At:	Stanford Le Hope

All samples will be retained for 6 months & certification are retained for a minimum of 5 years as per HSG 248

Analysts Signatory:		Approval Signature:	
Analysed By:	Samantha Plummer	Approved By:	Mike Mohan
Samples taken By:	George Dutton, Armstrong York	Survey Completed By:	

Samples of material referenced below have been examined to determine the presence of asbestos fibres using Armstrong York Asbestos Environmental Limited's in-house method of transmitted / polarized light microscopy and centre stop dispersion staining, based upon the HSE's "The Analysts Guide" & internal procedures TP04. Samples taken by authorised Armstrong York Asbestos Environmental Limited surveyors will be done under the internal TP05 procedure. **Armstrong York are not responsible for the accuracy or competence of third party sampling (client supplied samples and data). Client information will be recorded as supplied but is not the responsibility of Armstrong York. Under these circumstances Armstrong York will not be liable for additional materials that may subsequently be identified.**


Armstrong York Asbestos Environmental Ltd. Stanhope Industrial Park Wharf Road Stanford Le Hope Essex SS170EH – Tel 0870 3500 375 – Fax 0870 3500 376 – Reg No 4663503 – Registered Office 1 Royal Terrace Southend-on-Sea Essex SS1 1EJ

Laboratory locations: STANFORD LE HOPE: Stanhope Industrial Park Wharf Road Stanford Le Hope Essex SS170EH

SITE PLAN


ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD					Key	Identified ACM
Address	14 Jersey Close, Basingstoke, Hampshire			AY Number:	J276836	
Date:	14 Mar 2023	Floor	External	Building	1 Three bedroom house	
Client:	Sanctuary Group			Surveyor	George Dutton	

Inspection 14 - No suspect materials visually found

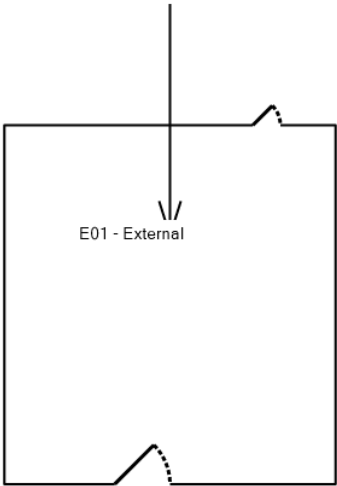


SITE PLAN

ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD					Key	Identified ACM
Address	14 Jersey Close, Basingstoke, Hampshire			AY Number:	J276836	
Date:	14 Mar 2023	Floor	Ground Floor	Building	1 Three bedroom house	
Client:	Sanctuary Group			Surveyor	George Dutton	

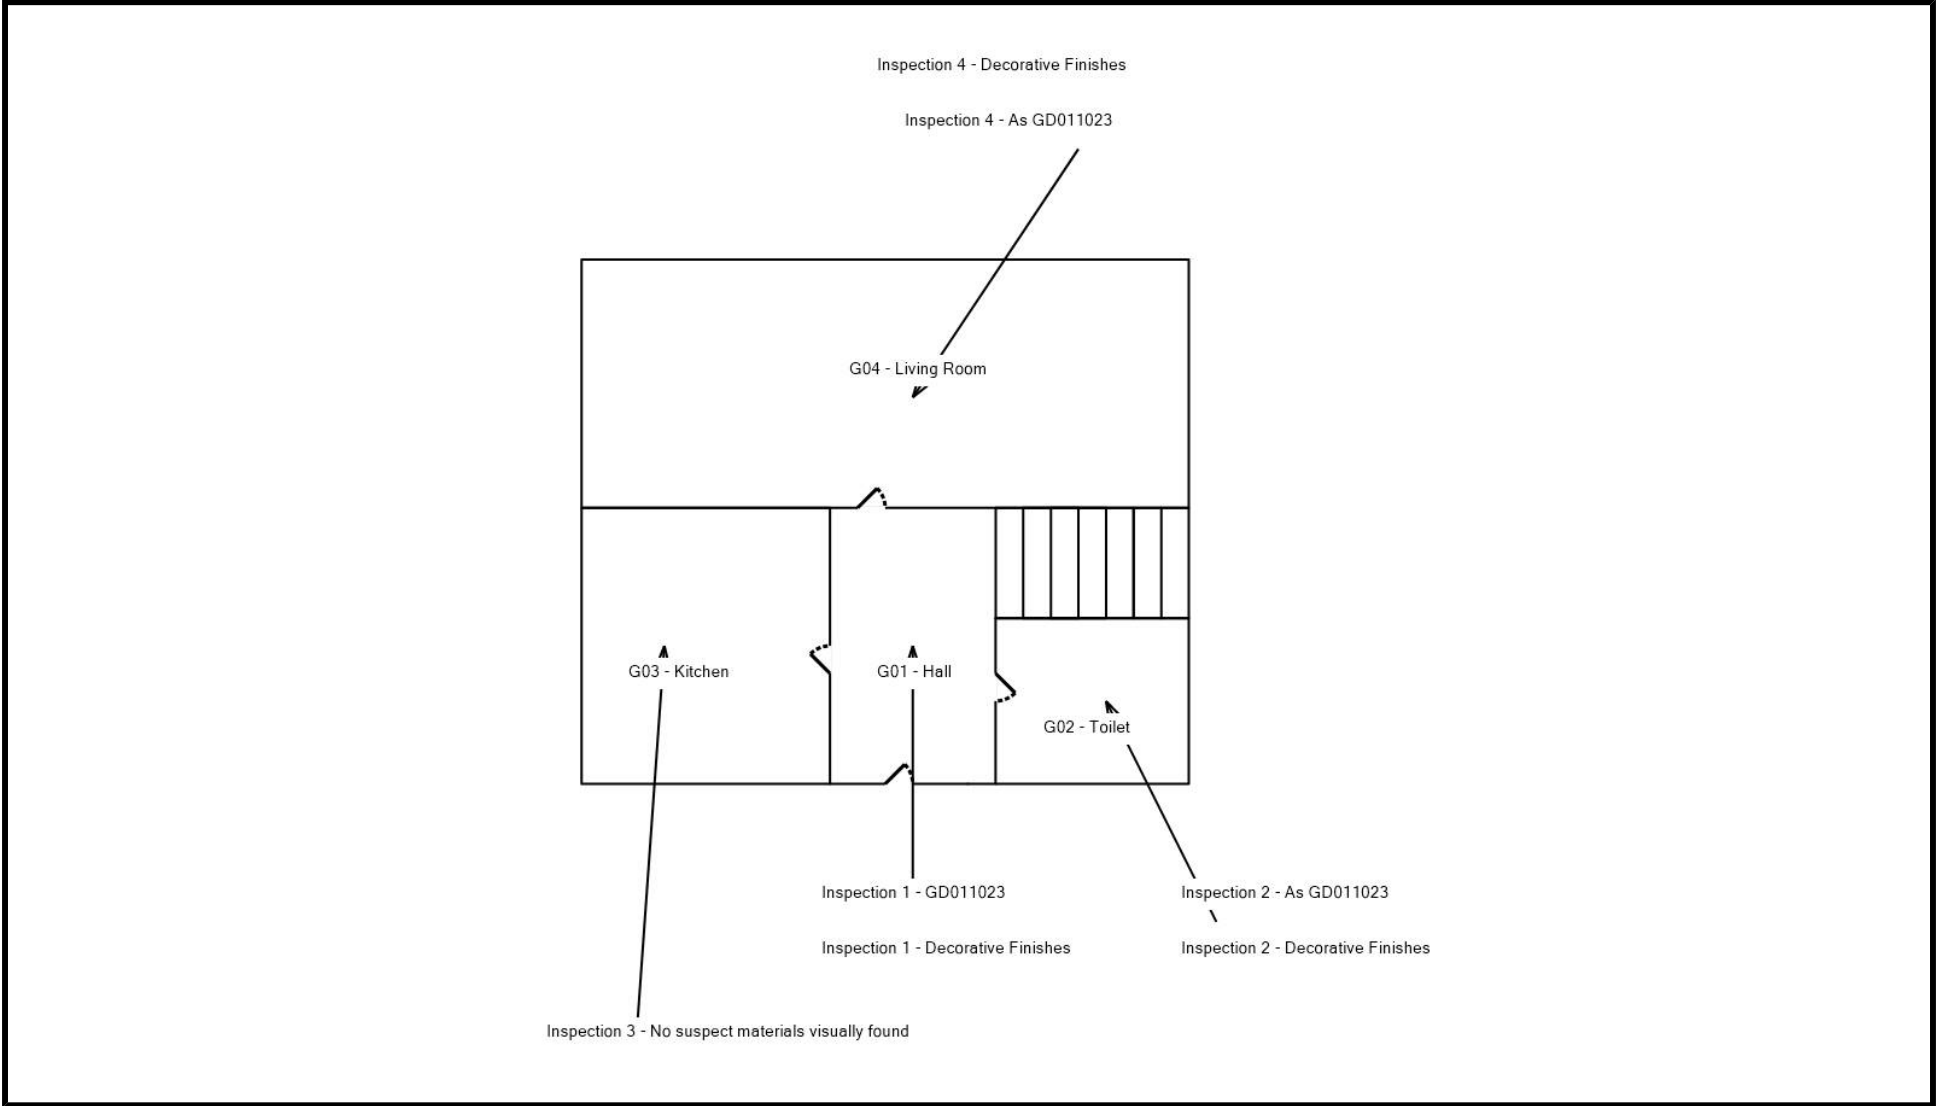

SITE PLAN

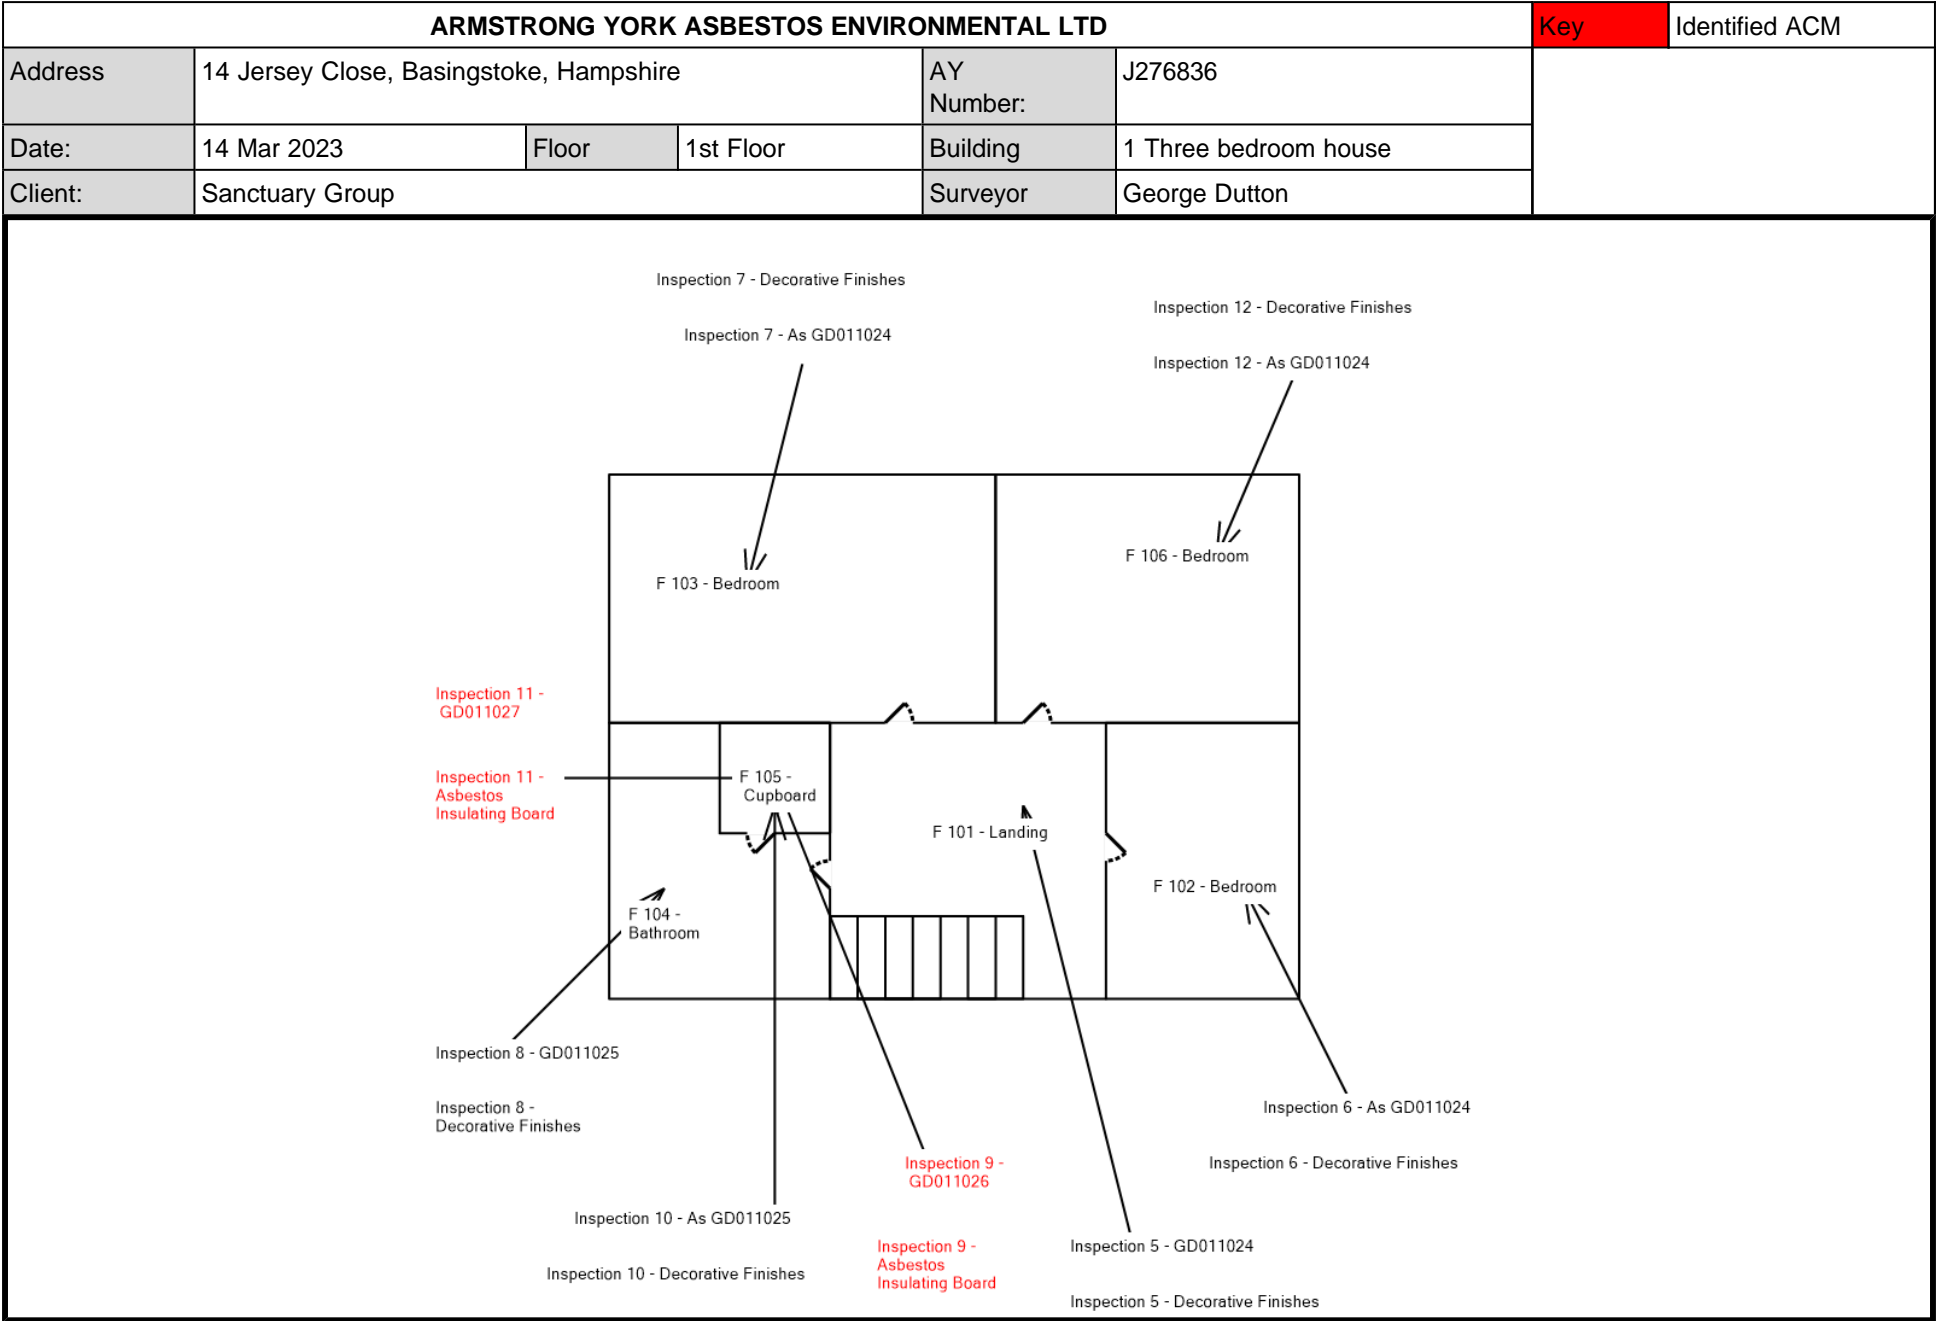

SITE PLAN

ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD					Key	Identified ACM
Address	14 Jersey Close, Basingstoke, Hampshire			AY Number:	J276836	
Date:	14 Mar 2023	Floor	Roof Void	Building	1 Three bedroom house	
Client:	Sanctuary Group			Surveyor	George Dutton	

Inspection 13 - Inaccessible

↓

∩∩

R01 - Loft Space

Control of Asbestos Regulations 2012

The Control of Asbestos Regulations 2012 applies to most work situations involving risk of exposure to asbestos. From 12th April 2012 the Control of Asbestos Regulations will require that employers:

- a) Take all reasonable steps to identify the locations of materials likely to contain asbestos.
- b) Assume that the identified materials contain asbestos, unless there is evidence to the contrary.
- c) Keep an up to date written record (Asbestos Register) of the location of asbestos-containing materials.
- d) Monitor the condition of asbestos-containing materials.
- e) Make a written assessment of the risk of exposure from asbestos
- f) Prepare and implement a management plan to control asbestos-related health risks, including measures to ensure that:
 - 1) Material known or presumed to create a risk of exposure to asbestos is repaired or, if necessary, removed.
 - 2) Material known or presumed to contain asbestos, but which does not pose a risk of exposure, is maintained in a good state of repair.
 - 3) Information about the location and condition of material known or presumed to contain asbestos is given to anyone who is likely to disturb it.

Other Health and Safety Regulations

Under Section 2 of the Health and Safety at Work etc. Act 1974, employers have a duty of care for the health, safety and welfare of their employees whilst at work. In addition, employers that are in control of premises have a duty of care, under Section 4 of the HSWA, towards all other people (non-employees) who use or work at their premises. Other regulations embodied in the HSWA require employers to ensure that:

- a) Immediate steps are taken to reduce exposure to asbestos, in situations where the control level or action level is exceeded.
- b) Risk assessments are carried out and are used to prepare method statements for any work that is likely to involve exposure to asbestos.
- c) The number of workers exposed to asbestos is kept to a minimum.
- d) Information on the location of asbestos is made available to any person likely to be exposed to ACM's.
- e) Training is given to anyone liable to be exposed to asbestos.

TERMS & CONDITIONS

General

- 1.1 The Employer warrants and undertakes that you have obtained and paid for all the necessary access, certificates, licenses, permits, permissions and consents required by Statute or any order or regulation made there under or by any regulation or by-law of any authority or statutory undertaker.
- 1.2 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD has based prices on the current rates for staff, labour, plant, stores and materials and we would require to be reimbursed for any increase that may occur between the date of this offer and the date of completion of the Works.
- 1.3 Unless explicitly stated within our offer ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD has made no allowance for working abnormal hours, outside of Monday to Friday 0800 to 1800hrs working, excluding where these constitute a Bank Holidays and should you require such overtime to be worked, then we would charge for any additional costs involved, except where explicitly stated as a consequence.
- 1.4 No allowance is made in our offer for escalation of incentive payments including fall back and condition monies resulting from any industrial dispute of local or national origin, or enhancement of incentive payments emanating from sources outside our control. In these events we shall require to be reimbursed for all such additional payments to our operatives which cannot be related to specific advancement in productivity levels and which are due solely to external influence beyond our control.
- 1.5 No allowance is made in our offer for enforced disruption or suspension of the Works arising from any form of industrial action beyond our control whether in the allied industries or any other local or national stoppage. Should any period of disruption occur or be anticipated, ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD, reserve the right to negotiate with the Employer the demobilisation of our resources until such time as we may resume normal working. In this event we shall require to be reimbursed for any necessary remobilisation costs and will establish with the Employer any necessary extension to our Contract Period.
- 1.6 Payment, referenced to this offer, shall be made by cheque payable to "ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD" or BACS payment to the account indicated on the invoice.
- 1.7 Our price is exclusive of any allowance for VAT. When payment is made VAT, if appropriate, should be added at the current standard rate.

- 1.8 Accounts will be rendered monthly as the Work proceeds. Payment of accounts without retention or discount is required within **thirty days from date of invoice** interest being chargeable on overdue accounts at **8%** above the Average Base Lending Rate of the four major clearing banks.
- 1.9 Our offer will remain open for acceptance for a period of 30 days from the date on our covering letter. If for any reason ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD is not permitted to commence the Work within 30 days of acceptance of our offer, we reserve the right to re-negotiate the rates.
- 1.10 Any rates quoted or standard schedules included relate to Works within the United Kingdom unless specifically stated to the contrary.
- 1.11 Reports and all other records provided by ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD are private and confidential between the Employer and ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD and they may not be used or relied upon by any other party without the prior consent of ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD.
- 1.12 Title in the reports together with all the information contained therein and all data generated under the contract between ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD and the Employer shall remain vested in ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD until the Employer has discharged all its obligations under Sections 1.6 to 1.8 inclusive above, whereupon the benefit shall be solely for the Employer, ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD assuming no obligations to third parties
- 1.13 Notwithstanding Condition 1.12 above, copyright and all intellectual property rights in the reports prepared by ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD for the Employer, shall remain vested in ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD.
- 1.14 Under no circumstances, shall ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD be liable to the Employer for any indirect or consequential loss suffered by the Employer relying on the information included in the reports prepared by ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD including (without limitation) loss of profit, loss of contracts or pure economic loss; ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD's liability under this contract is limited to loss or damages to goods or samples of the Employer caused by the proven negligence or breach of contract by ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD. Unless otherwise stated liquidated damages under this contract shall be nil.
- 1.15 Where the Employer intends to use any report or information provided by ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD, or any report and information becomes involved in litigation, then the Employer will both advise ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD in writing and seek the approval prior to using the report. ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD, reserve the right to refuse to provide a report for use in litigation.

- 1.16 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD can accept no liability for any damage or the consequence of any damage to mains and services such as cables, pipes, sewers, etc, the positions and nature of which are not clearly indicated in writing to us prior to the commencement of the Work. The rights and obligations under this condition shall be unaffected by any electronic or other searches we have made.
- 1.17 Permission for access and investigation where necessary shall be obtained by the Employer. ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD, have made no allowance for payment of wayleaves or for reinstatement or for compensation for unavoidable damage. ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD shall charge for any additional costs incurred.
- 1.18 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD shall require payment at the appropriate hourly rate for all delays due to circumstances beyond our control.
- 1.19 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD liability under any contract for laboratory testing shall be strictly limited to the invoice value of the analyses performed.
- 1.20 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD shall use all reasonable endeavours to meet quoted completion dates. However, time is not the essence of the contract and ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD shall not be liable in cases of late reporting, however caused, nor shall lateness be deemed to be a breach of contract or an act of negligence.
- 1.21 Testing and/or analysis reports refer only to the actual samples on which testing has been performed. No report shall be read as implying that any sample or mass from which the sample was drawn is fit for any intended purpose unless explicitly stated in writing by ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD.
- 1.22 Any contract for consulting services shall be based on the Change as agreed issued by the Institution of Civil Engineers except where they are amended by the conditions herein.
- 1.23 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD's total liability under a contract solely for advisory and consulting services shall be limited to one million pounds sterling unless amended by particular contract correspondence.
- 1.24 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD's liability if proven under a contract where no advisory or consulting services have been provided shall be limited to the value of the specific work undertaken for the portion of the works related to the claim.

- 1.25 This offer is made in accordance with the provisions outlined in The Construction (Design and Management) Regulations 1994 under which the contracted Division of ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD will act as Contractor or Principal Contractor, as appropriate.
- 1.26 The total liability of ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD to the Employer whether as to specie, quantum or duration of liability, is set out in the contract between the Employer and ARMSTRONG-YORK ASBESTOS ENVIRONMENTAL LTD and no other obligations are to be implied into the contract, whether as to the giving of bonds, warranties or guarantees.
- 1.27 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD conducts a strict confidentiality policy which is signed by all staff.
- 1.28 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD Internal/external Documents are controlled within a controlled document system.
- 1.29 ARMSTRONG YORK ASBESTOS ENVIRONMENTAL LTD uses password protection, server back up and access control to all of its computer systems